
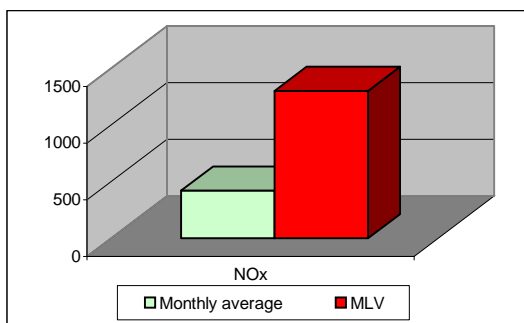
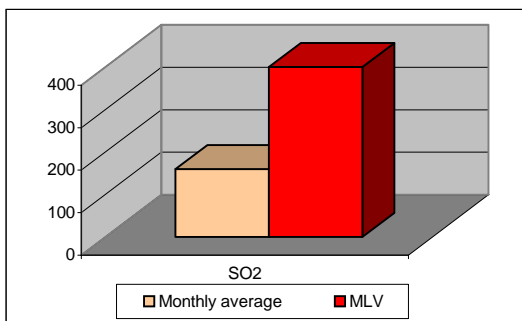


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE



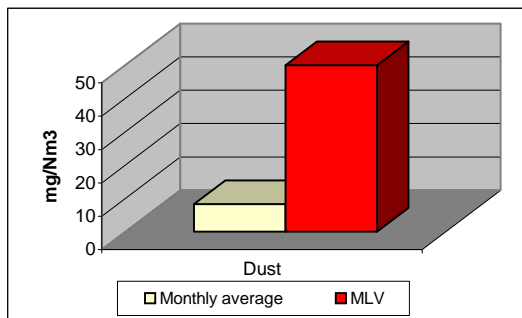


January 2008	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	12	50	89	400	268	1300	
2	11	50	86	400	311	1300	
3	12	50	70	400	422	1300	
4	12	50	91	400	476	1300	
5	14	50	111	400	512	1300	
6	14	50	154	400	571	1300	
7	12	50	106	400	523	1300	
8	12	50	168	400	392	1300	
9	12	50	174	400	442	1300	
10	13	50	177	400	589	1300	
11	13	50	178	400	563	1300	
12	13	50	197	400	487	1300	
13	12	50	288	400	470	1300	
14	11	50	307	400	576	1300	
15	8	50	311	400	487	1300	
16	6	50	237	400	463	1300	
17	5	50	154	400	377	1300	
18	6	50	185	400	398	1300	
19	6	50	203	400	283	1300	
20	5	50	214	400	314	1300	
21	5	50	143	400	416	1300	
22	4	50	104	400	360	1300	
23	4	50	84	400	448	1300	
24		50		400		1300	
25		50		400		1300	
26		50		400		1300	
27		50		400		1300	
28	4	50	195	400	425	1300	
29	4	50	173	400	438	1300	
30	4	50	141	400	382	1300	
31	5	50	142	400	224	1300	
Average	8	50	160	400	421	1300	

Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O₂. Results of the measurements are represented in Nm³ (Nm³ - T=273K, P=101,3kP, dry gas)

MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE

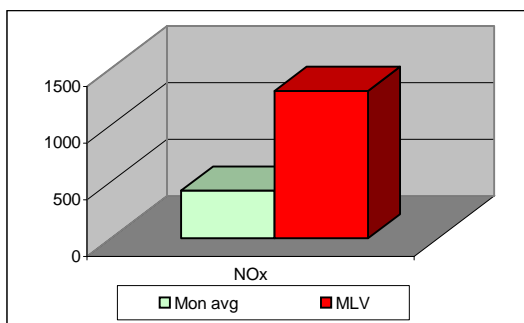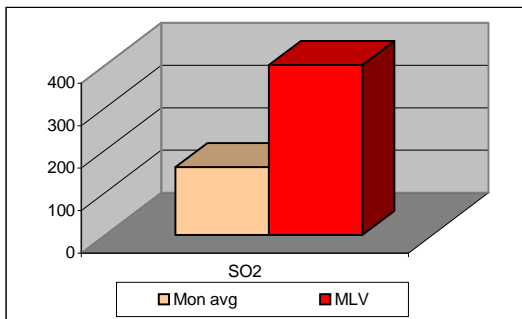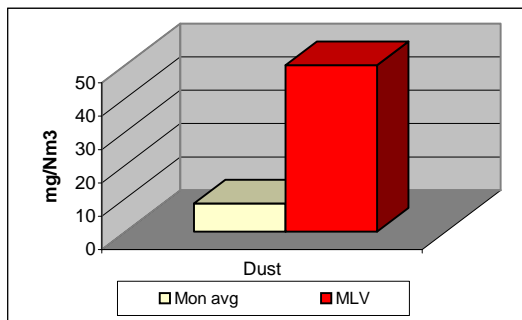

January 2008	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	11	50	137	400	134	1300	
2	12	50	138	400	271	1300	
3	13	50	111	400	268	1300	
4	11	50	90	400	121	1300	
5	13	50	117	400	128	1300	
6	14	50	165	400	219	1300	
7	12	50	130	400	68	1300	
8	12	50	219	400	124	1300	
9	12	50	184	400	299	1300	
10	14	50	260	400	186	1300	
11	15	50	293	400	479	1300	
12	14	50	311	400	613	1300	
13	14	50	324	400	414	1300	
14	12	50	334	400	305	1300	
15	11	50	312	400	392	1300	
16	8	50	211	400	297	1300	
17	4	50	113	400	259	1300	
18	5	50	159	400	263	1300	
19	5	50	213	400	211	1300	
20	5	50	205	400	280	1300	
21	6	50	162	400	311	1300	
22	5	50	144	400	146	1300	
23	4	50	89	400	47	1300	
24		50		400		1300	
25		50		400		1300	
26		50		400		1300	
27		50		400		1300	
28	3	50	210	400	333	1300	
29	4	50	156	400	327	1300	
30	3	50	166	400	346	1300	
31	4	50	224	400	259	1300	
Average	8	50	160	400	421	1300	

Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O₂. Results of the measurements are represented in Nm³ (Nm³ - T=273K, P=101,3kP, dry gas)