
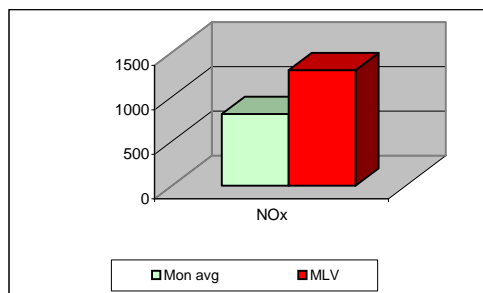
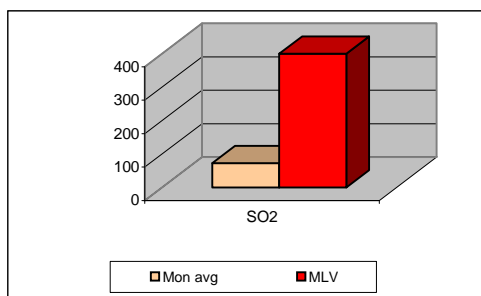


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.3



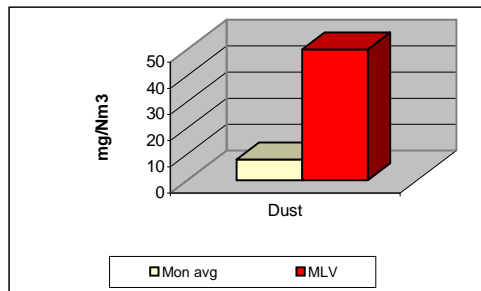


May 2011	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	8	50	126	400	888	1300	
2	8	50	142	400	923	1300	
3	8	50	135	400	939	1300	
4	8	50	100	400	782	1300	
5	8	50	73	400	911	1300	
6	8	50	78	400	861	1300	
7	8	50	77	400	910	1300	
8	8	50	48	400	669	1300	
9	8	50	63	400	692	1300	
10	/	50	/	400	/	1300	
11	/	50	/	400	/	1300	
12	/	50	/	400	/	1300	
13	/	50	/	400	/	1300	
14	/	50	/	400	/	1300	
15	/	50	/	400	/	1300	
16	/	50	/	400	/	1300	
17	/	50	/	400	/	1300	
18	7	50	86	400	642	1300	
19	7	50	39	400	582	1300	
20	8	50	42	400	864	1300	
21	8	50	40	400	703	1300	
22	8	50	43	400	740	1300	
23	8	50	65	400	623	1300	
24	8	50	73	400	754	1300	
25	8	50	86	400	910	1300	
26	8	50	100	400	821	1300	
27	8	50	73	400	717	1300	
28	8	50	57	400	961	1300	
29	8	50	43	400	818	1300	
30	8	50	35	400	960	1300	
31	8	50	41	400	942	1300	
Average	8	50	72	400	809	1300	

MLV: Maximum Limit Value

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O₂
Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c

MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.4

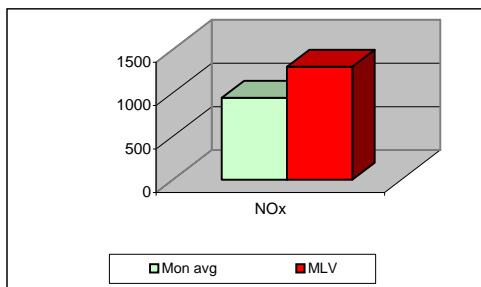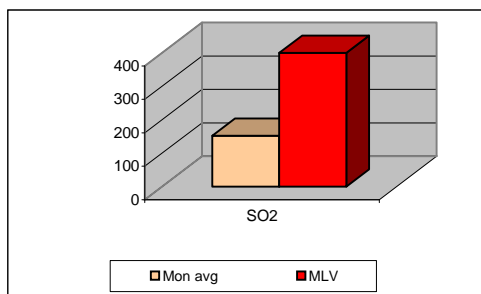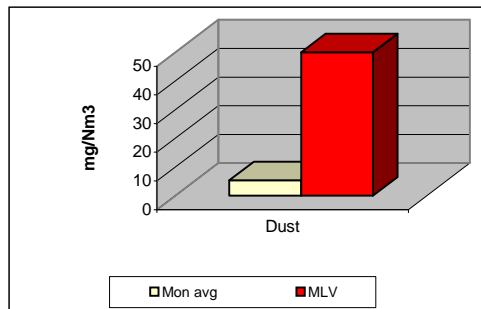

May 2011	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	0	50	269	400	1126	1300	
2	0	50	196	400	1070	1300	
3	1	50	212	400	1080	1300	
4	0,2	50	224	400	1099	1300	
5	0	50	177	400	987	1300	
6	0,1	50	221	400	1048	1300	
7	0	50	162	400	1060	1300	
8	0	50	165	400	1029	1300	
9	0,1	50	145	400	978	1300	
10	3	50	124	400	966	1300	
11	7	50	110	400	978	1300	
12	7	50	143	400	1040	1300	
13	0	50	105	400	1089	1300	
14	7	50	223	400	762	1300	
15	0	50	132	400	694	1300	
16	/	50	/	400	/	1300	
17	/	50	/	400	/	1300	
18	/	50	/	400	/	1300	
19	/	50	/	400	/	1300	
20	/	50	/	400	/	1300	
21	/	50	/	400	/	1300	
22	/	50	/	400	/	1300	
23	/	50	/	400	/	1300	
24	0	50	128	400	867	1300	
25	7	50	84	400	799	1300	
26	7	50	96	400	780	1300	
27	4	50	119	400	742	1300	
28	7	50	95	400	906	1300	
29	11	50	98	400	770	1300	
30	13	50	117	400	964	1300	
31	6	50	152	400	868	1300	
Average	5	50	152	400	944	1300	

MLV: Maximum Limit Value

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O₂
 Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c