
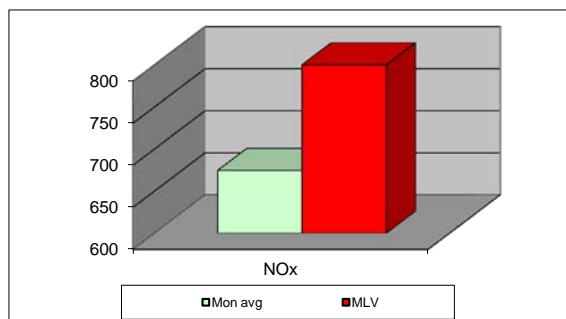
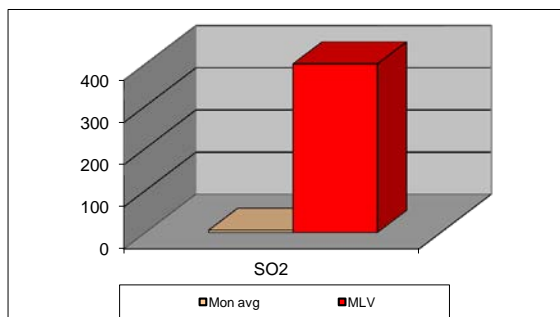


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.3

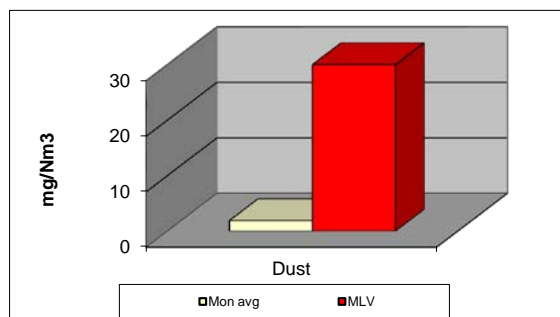




March 2017	Dust (mg/Nm ³) МДК 30mg/m ³	МДК 30mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NO _x (mg/Nm ³) МДК 800mg/m ³	МДК 800mg/m ³	Comments
01.03.2017		30		400		800	
02.03.2017		30		400		800	
03.03.2017		30		400		800	
04.03.2017		30		400		800	
05.03.2017		30		400		800	
06.03.2017		30		400		800	
07.03.2017		30		400		800	
08.03.2017		30		400		800	
09.03.2017		30		400		800	
10.03.2017		30		400		800	
11.03.2017		30		400		800	
12.03.2017		30		400		800	
13.03.2017		30		400		800	
14.03.2017		30		400		800	
15.03.2017		30		400		800	
16.03.2017		30		400		800	
17.03.2017		30		400		800	
18.03.2017		30		400		800	
19.03.2017		30		400		800	
20.03.2017		30		400		800	
21.03.2017	1,26	30	6,08	400	678	800	
22.03.2017	1,6	30	7,07	400	696,71	800	
23.03.2017	2,11	30	4,95	400	658,59	800	
24.03.2017	1,76	30	2,59	400	618,77	800	
25.03.2017	2,6	30	5,92	400	706,78	800	
26.03.2017	2,1	30	4,5	400	732,57	800	
27.03.2017	1,25	30	5,93	400	615,48	800	
28.03.2017	1,63	30	6,74	400	712,36	800	
29.03.2017	2,04	30	5,66	400	697,44	800	
30.03.2017	2,12	30	4,07	400	653,83	800	
31.03.2017	2,33	30	5,37	400	648,23	800	
Average	1,89	30	5,35	400	674,43	800	

MLV: Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O2
Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas).

Note: Kiln no.3 was not In operation until 21.03.2017

MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.4

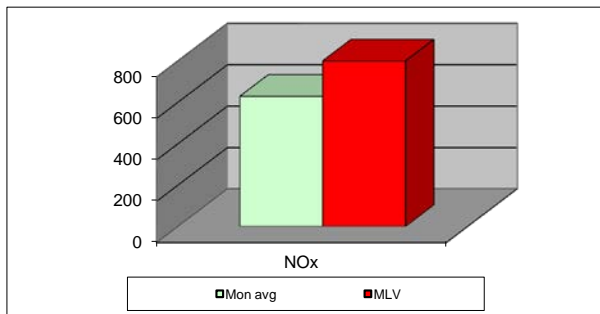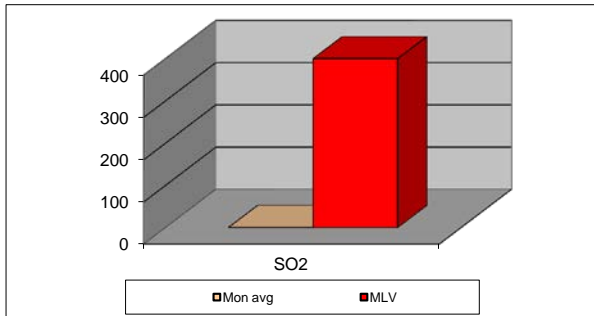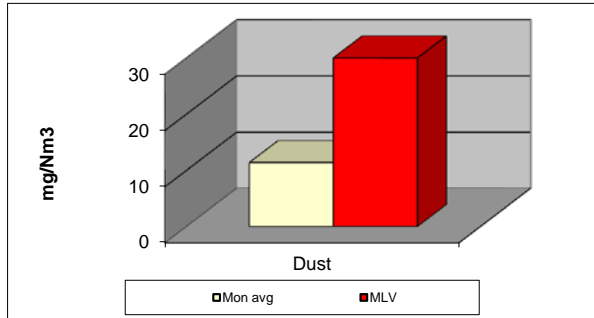

March 2017	Dust (mg/Nm ³) МДК 30mg/m ³	МДК 30mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 800mg/m ³	МДК 800mg/m ³	Comments
01.03.2017		30		400		800	
02.03.2017		30		400		800	
03.03.2017		30		400		800	
04.03.2017		30		400		800	
05.03.2017		30		400		800	
06.03.2017		30		400		800	
07.03.2017	9,48	30	0,05	400	581,18	800	
08.03.2017	11,63	30	0,37	400	653,56	800	
09.03.2017	13,78	30	0,17	400	630,33	800	
10.03.2017	11,96	30	0,07	400	679,57	800	
11.03.2017	10,64	30	0,76	400	658,25	800	
12.03.2017	12,48	30	1,66	400	647,61	800	
13.03.2017	10,83	30	0,49	400	665,55	800	
14.03.2017	14,25	30	1,49	400	671,01	800	
15.03.2017	13,75	30	0,89	400	676,95	800	
16.03.2017	13,99	30	0,98	400	540,38	800	
17.03.2017	12,29	30	0,23	400	601,81	800	
18.03.2017	13,1	30	0,25	400	593,06	800	
19.03.2017	10,43	30	0,17	400	624,38	800	
20.03.2017	12,19	30	0,22	400	647,78	800	
21.03.2017	12,09	30	0,33	400	585,01	800	
22.03.2017	11,07	30	0,59	400	644,07	800	
23.03.2017	10,31	30	0,78	400	606,08	800	
24.03.2017	10,59	30	0,72	400	640,18	800	
25.03.2017	10,81	30	0,68	400	646,93	800	
26.03.2017	10,62	30	0,57	400	716,08	800	
27.03.2017	9,66	30	0,48	400	628,1	800	
28.03.2017	8,97	30	0,22	400	557,31	800	
29.03.2017	7,87	30	0,29	400	620,04	800	
30.03.2017	7,07	30	0,56	400	616,76	800	
31.03.2017	14,52	30	0,32	400	593,03	800	
Average	11,38	30	0,53	400	629,00	800	

MLV: Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O2
Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas).

Note: Kiln no.4 was not In operation until 07.03.2017