
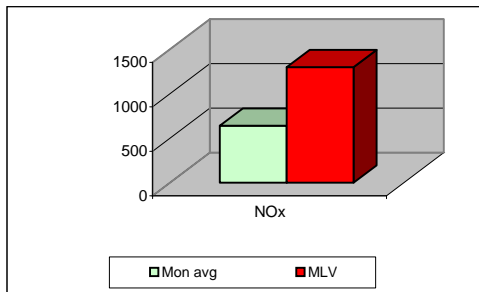
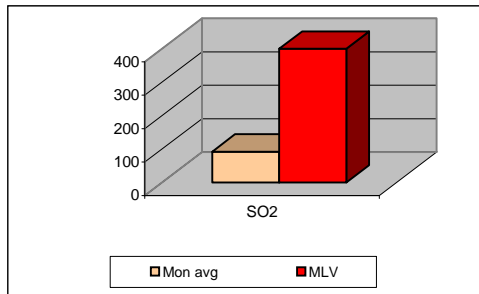


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.3



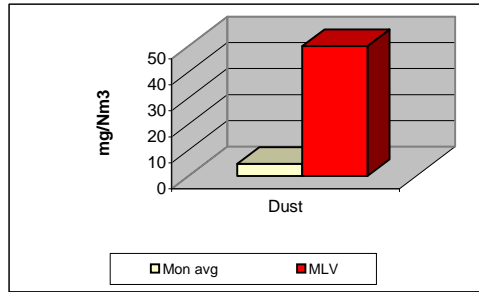


November 2010	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	6	50	83	400	685	1300	
2	6	50	76	400	669	1300	
3	6	50	68	400	626	1300	
4	6	50	92	400	591	1300	
5	5	50	130	400	469	1300	
6	7	50	63	400	674	1300	
7	7	50	90	400	577	1300	
8	7	50	111	400	591	1300	
9	4	50	97	400	656	1300	
10	4	50	101	400	748	1300	
11	4	50	131	400	797	1300	
12	4	50	81	400	603	1300	
13	4	50	100	400	539	1300	
14	4	50	73	400	772	1300	
15	4	50	82	400	592	1300	
16	4	50	108	400	696	1300	
17	5	50	128	400	632	1300	
18	4	50	95	400	622	1300	
19	5	50	136	400	630	1300	
20	4	50	141	400	642	1300	
21	4	50	111	400	670	1300	
22	4	50	104	400	710	1300	
23	4	50	115	400	666	1300	
24	4	50	81	400	629	1300	
25	5	50	41	400	646	1300	
26	4	50	62	400	645	1300	
27	4	50	64	400	620	1300	
28	4	50	53	400	696	1300	
29	4	50	69	400	547	1300	
30	4	50	79	400	651	1300	
31		50		400		1300	
Average	5	50	92	400	643	1300	

MLV: Maximum Limit Value

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O₂
Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c

MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.4

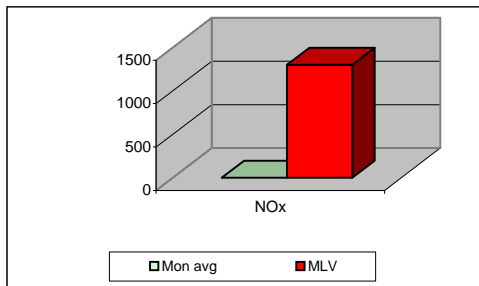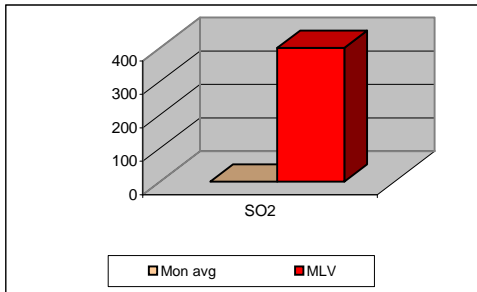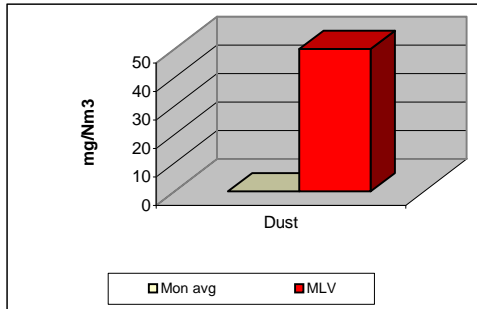

November 2010	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NO _x (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1		50		400		1300	
2		50		400		1300	
3		50		400		1300	
4		50		400		1300	
5		50		400		1300	
6		50		400		1300	
7		50		400		1300	
8		50		400		1300	
9		50		400		1300	
10		50		400		1300	
11		50		400		1300	
12		50		400		1300	
13		50		400		1300	
14		50		400		1300	
15		50		400		1300	
16		50		400		1300	
17		50		400		1300	
18		50		400		1300	
19		50		400		1300	
20		50		400		1300	
21		50		400		1300	
22		50		400		1300	
23		50		400		1300	
24		50		400		1300	
25		50		400		1300	
26		50		400		1300	
27		50		400		1300	
28		50		400		1300	
29		50		400		1300	
30		50		400		1300	
31		50		400		1300	
Average	0	50	0	400	0	1300	

MLV: Maximum Limit Value

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O₂
 Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c