
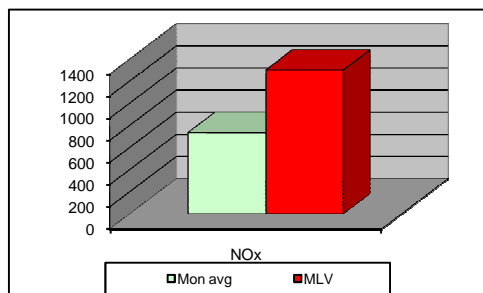
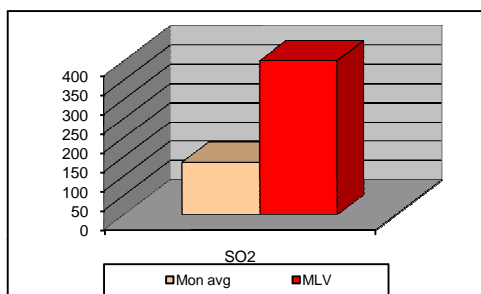


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE



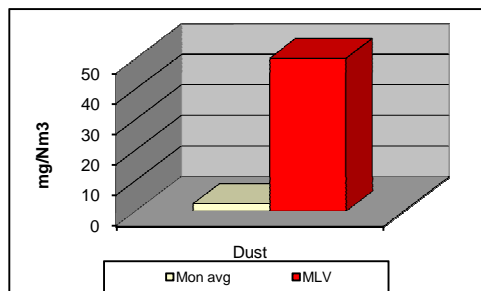


March 2009	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	3	50	114	400	800	1300	
2	3	50	140	400	809	1300	
3	3	50	269	400	669	1300	
4	3	50	212	400	716	1300	
5	3	50	164	400	776	1300	
6	3	50	92	400	770	1300	
7	3	50	119	400	875	1300	
8		50		400		1300	
9		50		400		1300	
10	3	50	100	400	879	1300	
11	3	50	93	400	812	1300	
12	3	50	112	400	917	1300	
13	4	50	105	400	934	1300	
14	3	50	85	400	811	1300	
15	3	50	93	400	734	1300	
16	3	50	78	400	641	1300	
17	3	50	121	400	710	1300	
18	3	50	197	400	725	1300	
19	2	50	149	400	718	1300	
20	2	50	171	400	783	1300	
21	2	50	170	400	570	1300	
22	2	50	146	400	660	1300	
23	2	50	152	400	594	1300	
24	1	50	97	400	661	1300	
25	2	50	103	400	695	1300	
26	2	50	120	400	732	1300	
27	2	50	143	400	628	1300	
28	2	50	182	400	783	1300	
29	1	50	133	400	649	1300	
30	1	50	117	400	679	1300	
31	1	50	138	400	703	1300	
Average	2	50	136	400	734	1300	

Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O₂. Results of the measurements are represented in Nm³ (Nm³ - T=273K, P=101,3kP, dry gas)

MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE

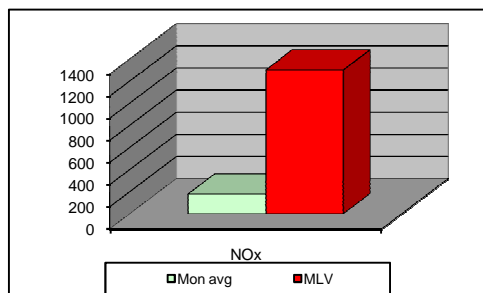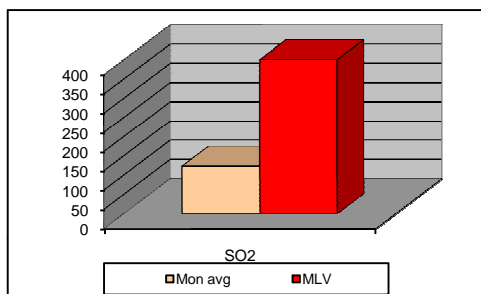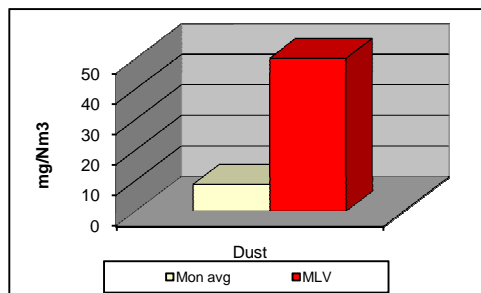

March 2009	Dust (mg/Nm ³)		SO ₂ (mg/Nm ³)		NOx (mg/Nm ³)		Comments
	МДК 50mg/m ³	МДК 50mg/m ³	МДК 400mg/m ³	МДК 400mg/m ³	МДК 1300mg/m ³	МДК 1300mg/m ³	
1	5	50	102	400	175	1300	
2	4	50	74	400	229	1300	
3	5	50	253	400	376	1300	
4	9	50	261	400	519	1300	
5	8	50	175	400	269	1300	
6	9	50	129	400	158	1300	
7	9	50	127	400	125	1300	
8	9	50	141	400	180	1300	
9	10	50	240	400	192	1300	
10	10	50	135	400	211	1300	
11	9	50	87	400	91	1300	
12	10	50	90	400	184	1300	
13	11	50	96	400	204	1300	
14	9	50	78	400	185	1300	
15	9	50	82	400	65	1300	
16	9	50	84	400	145	1300	
17	9	50	99	400	204	1300	
18	9	50	108	400	126	1300	
19	9	50	89	400	42	1300	
20	10	50	100	400	274	1300	
21	10	50	104	400	151	1300	
22	10	50	99	400	251	1300	
23	8	50	115	400	73	1300	
24	8	50	127	400	85	1300	
25	10	50	138	400	176	1300	
26	8	50	147	400	158	1300	
27	8	50	132	400	211	1300	
28	11	50	170	400	270	1300	
29		50		400		1300	
30		50		400		1300	
31		50		400		1300	
Average	9	50	123	400	178	1300	

Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O₂. Results of the measurements are represented in Nm³ (Nm³ - T=273K, P=101,3kP, dry gas)