
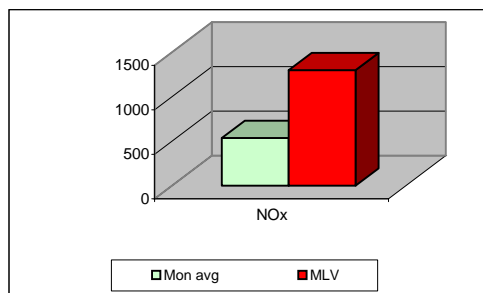
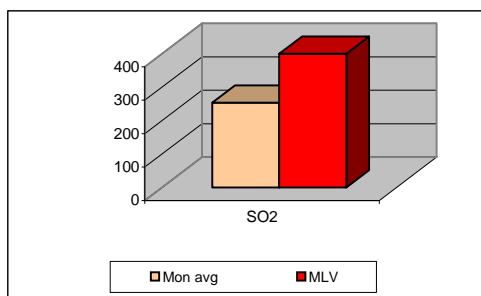


## MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.3



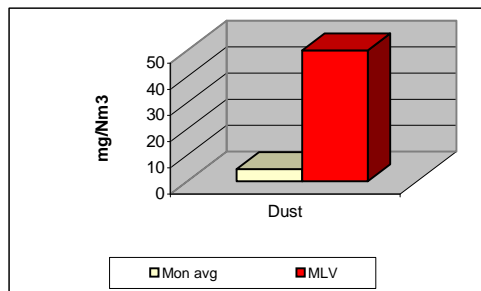


June 2010	Dust (mg/Nm <sup>3</sup> ) МДК 50mg/m <sup>3</sup>	МДК 50mg/m <sup>3</sup>	SO <sub>2</sub> (mg/Nm <sup>3</sup> ) МДК 400mg/m <sup>3</sup>	МДК 400mg/m <sup>3</sup>	NOx (mg/Nm <sup>3</sup> ) МДК 1300mg/m <sup>3</sup>	МДК 1300mg/m <sup>3</sup>	Comments
1		50		400		1300	
2	5	50	218	400	476	1300	
3	5	50	194	400	628	1300	
4	6	50	230	400	719	1300	
5	8	50	316	400	709	1300	
6	7	50	351	400	898	1300	
7	6	50	280	400	536	1300	
8	4	50	249	400	499	1300	
9	4	50	246	400	616	1300	
10	4	50	279	400	388	1300	
11	5	50	286	400	557	1300	
12	4	50	254	400	604	1300	
13	5	50	258	400	623	1300	
14	3	50	263	400	563	1300	
15	3	50	266	400	481	1300	
16	3	50	276	400	469	1300	
17	3	50	340	400	454	1300	
18	4	50	301	400	449	1300	
19	4	50	264	400	439	1300	
20	4	50	227	400	458	1300	
21	4	50	190	400	372	1300	
22	4	50	213	400	459	1300	
23	4	50	140	400	389	1300	
24		50		400		1300	
25		50		400		1300	
26		50		400		1300	
27		50		400		1300	
28		50		400		1300	
29		50		400		1300	
30		50		400		1300	
31	3	50	176	400	771	1300	
<b>Average</b>	<b>5</b>	<b>50</b>	<b>254</b>	<b>400</b>	<b>539</b>	<b>1300</b>	

**MLV: Maximum Limit Value**

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O<sub>2</sub>  
Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c

## MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE - KILN No.4

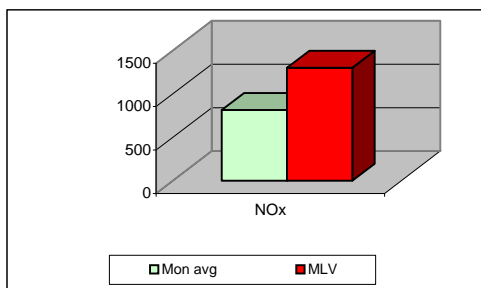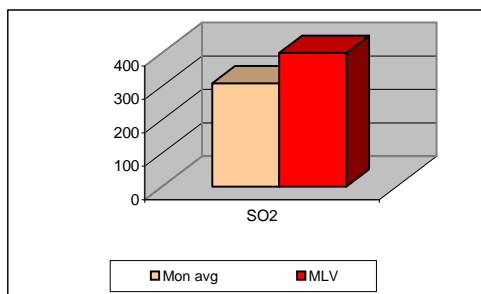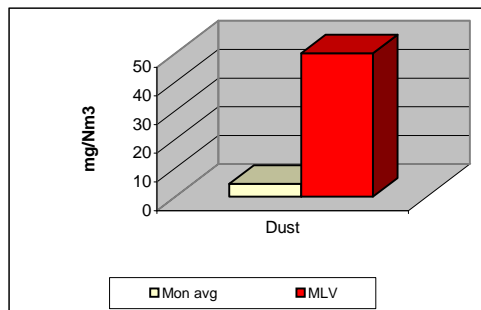

June 2010	Dust (mg/Nm <sup>3</sup> ) МДК 50mg/m <sup>3</sup>	МДК 50mg/m <sup>3</sup>	SO <sub>2</sub> (mg/Nm <sup>3</sup> ) МДК 400mg/m <sup>3</sup>	МДК 400mg/m <sup>3</sup>	NOx (mg/Nm <sup>3</sup> ) МДК 1300mg/m <sup>3</sup>	МДК 1300mg/m <sup>3</sup>	Comments
1		50		400		1300	
2		50		400		1300	
3		50		400		1300	
4		50		400		1300	
5	4	50	187	400	663	1300	
6	4	50	285	400	662	1300	
7	4	50	280	400	605	1300	
8	4	50	285	400	722	1300	
9	4	50	291	400	585	1300	
10	5	50	339	400	1244	1300	
11	5	50	356	400	836	1300	
12	5	50	308	400	596	1300	
13	5	50	289	400	738	1300	
14	5	50	296	400	891	1300	
15	5	50	298	400	791	1300	
16	4	50	303	400	668	1300	
17	5	50	313	400	767	1300	
18	5	50	329	400	809	1300	
19	5	50	302	400	914	1300	
20	5	50	306	400	802	1300	
21	5	50	309	400	675	1300	
22	5	50	300	400	850	1300	
23	5	50	300	400	983	1300	
24	4	50	354	400	966	1300	
25	5	50	351	400	951	1300	
26	5	50	324	400	989	1300	
27	5	50	325	400	927	1300	
28	5	50	311	400	1036	1300	
29	5	50	356	400	795	1300	
30	5	50	337	400	693	1300	
31		50		400		1300	
<b>Average</b>	<b>4</b>	<b>50</b>	<b>309</b>	<b>400</b>	<b>814</b>	<b>1300</b>	

**MLV: Maximum Limit Value**

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O<sub>2</sub>  
 Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c