
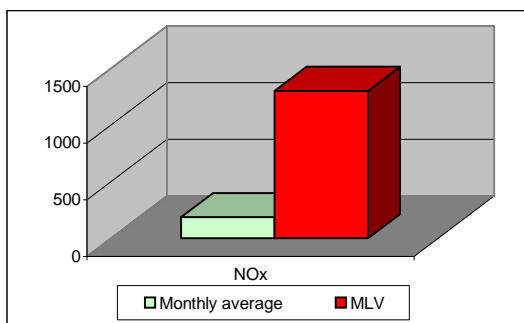
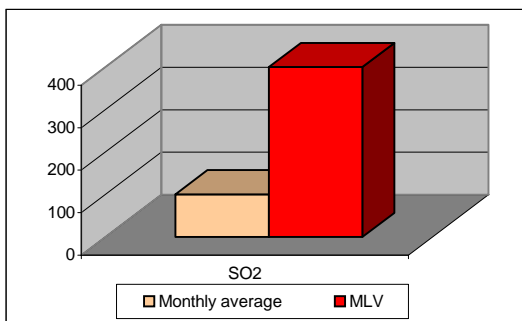


## MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE- Pecka 3



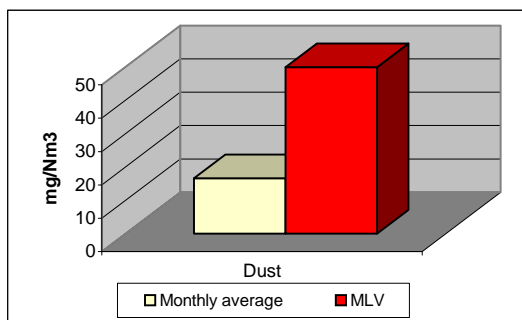


February 2008 Pecka 3	Dust (mg/Nm <sup>3</sup> ) МДК 50mg/m <sup>3</sup>	SO <sub>2</sub> (mg/Nm <sup>3</sup> ) МДК 400mg/m <sup>3</sup>	NO <sub>x</sub> (mg/Nm <sup>3</sup> ) МДК 1300mg/m <sup>3</sup>	Comments
1	12	157	288	
2	13	125	151	
3	14	101	111	
4	14	64	155	
5	19	62	154	
6	39	55	343	
7	9	71	277	
8	9	79	147	
9	13	106	185	
10	15	93	159	
11	17	107	124	
12	18	128	90	
13	21	164	154	
14	20	97	275	
15				во ремонт
16				во ремонт
17				во ремонт
18				во ремонт
19				во ремонт
20				во ремонт
21				во ремонт
22				во ремонт
23				во ремонт
24				во ремонт
25				во ремонт
26				во ремонт
27				во ремонт
28				во ремонт
29				во ремонт
30				во ремонт
31				во ремонт
<b>Average</b>	<b>17</b>	<b>101</b>	<b>187</b>	

### Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O<sub>2</sub>. Results of the measurements are represented in Nm<sup>3</sup> (Nm<sup>3</sup> - T=273K, P=101,3kP, dry gas)

## MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE- Pecka 4

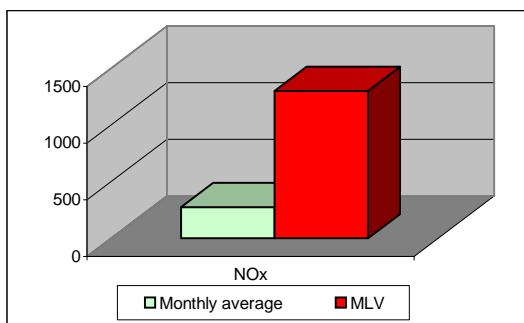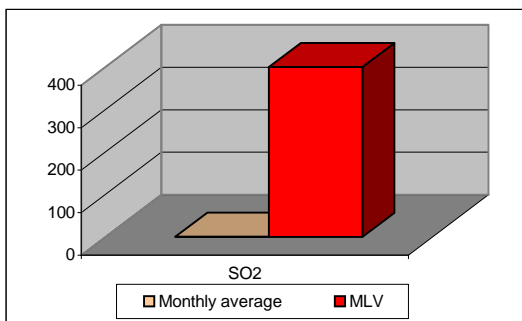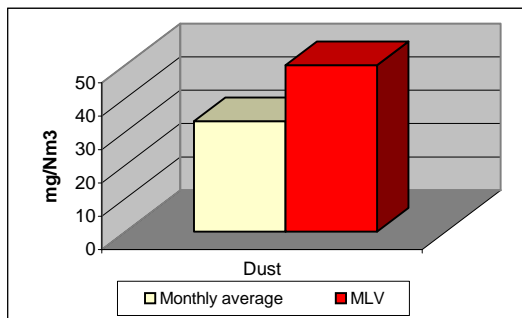

February 2008 Pecka 4	Dust (mg/Nm <sup>3</sup> ) МДК 50mg/m <sup>3</sup>	МДК 50mg/m <sup>3</sup>	SO <sub>2</sub> (mg/Nm <sup>3</sup> ) МДК 400mg/m <sup>3</sup>	МДК 400mg/m <sup>3</sup>	NOx (mg/Nm <sup>3</sup> ) МДК 1300mg/m <sup>3</sup>	МДК 1300mg/m <sup>3</sup>	Comments
1	34	50	222	400	275	1300	
2	33	50	187	400	122	1300	
3	31	50	150	400	100	1300	
4	32	50	115	400	459	1300	
5	29	50	119	400	217	1300	
6	34	50	152	400	283	1300	
7	44	50	157	400	198	1300	
8	40	50	206	400	261	1300	
9	32	50	228	400	255	1300	
10	30	50	171	400	247	1300	
11	32	50	204	400	149	1300	
12	34	50	261	400	109	1300	
13	37	50	297	400	219	1300	
14	36	50	197	400	256	1300	
15	36	50	240	400	119	1300	
16	36	50	170	400	202	1300	
17	37	50	178	400	101	1300	
18	35	50	227	400	21	1300	
19	35	50	313	400	16	1300	
20	33	50	317	400	124	1300	
21		50		400		1300	
22	30	50	104	400	593	1300	
23	30	50	50	400	552	1300	
24	30	50	59	400	441	1300	
25	32	50	67	400	600	1300	
26	27	50	28	400	375	1300	
27	27	50	29	400	553	1300	
28	28	50	54	400	442	1300	
29	33	50	47	400	268	1300	
30		50		400		1300	
31		50		400		1300	
<b>Average</b>	<b>33</b>	<b>50</b>	<b>1</b>	<b>400</b>	<b>275</b>	<b>1300</b>	

### Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O<sub>2</sub>. Results of the measurements are represented in Nm<sup>3</sup> (Nm<sup>3</sup> - T=273K, P=101,3kP, dry gas)