
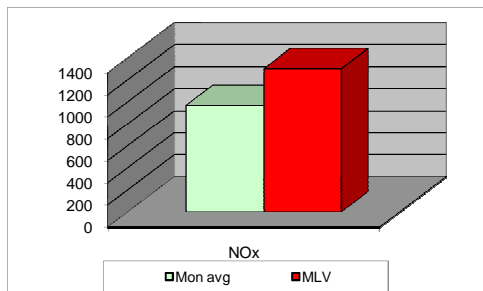
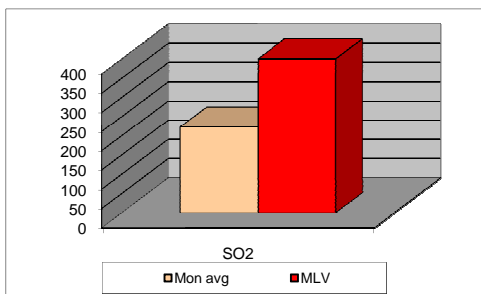


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE-KILN 4

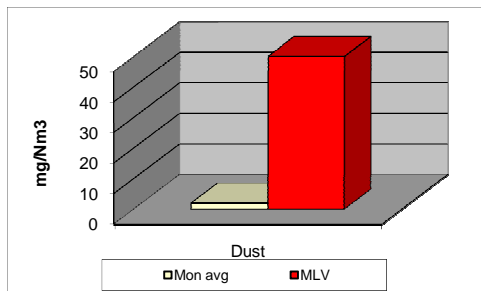

October 2009	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	2	50	250	400	962	1300	
2	1	50	276	400	813	1300	
3	2	50	200	400	945	1300	
4	1	50	181	400	987	1300	
5	2	50	189	400	997	1300	
6	2	50	207	400	777	1300	
7	2	50	247	400	882	1300	
8	2	50	268	400	1033	1300	
9	2	50	234	400	1003	1300	
10	2	50	263	400	1158	1300	
11	2	50	252	400	1078	1300	
12	2	50	248	400	943	1300	
13	2	50	324	400	1019	1300	
14	2	50	298	400	1103	1300	
15	2	50	209	400	1127	1300	
16	2	50	238	400	959	1300	
17	2	50	200	400	869	1300	
18	2	50	180	400	899	1300	
19	2	50	219	400	982	1300	
20	2	50	184	400	997	1300	
21	2	50	220	400	936	1300	
22	2	50	196	400	1077	1300	
23	2	50	203	400	974	1300	
24	2	50	225	400	903	1300	
25	2	50	247	400	1004	1300	
26	2	50	202	400	1034	1300	
27	2	50	194	400	960	1300	
28	2	50	211	400	905	1300	
29	2	50	229	400	893	1300	
30	2	50	177	400	922	1300	
31	2	50	140	400	880	1300	
Average	2	50	223	400	968	1300	

MLV: Maximum Limit Value

Eplanations: The monthly average values are calculated on the half hour emissin values. Measured values of the concentrations are calculated at 10 vol. of O₂
 Results of the measurments are represented in Nm3 (Nm3 - T=273K, P=101,3kP, dry gas)c