
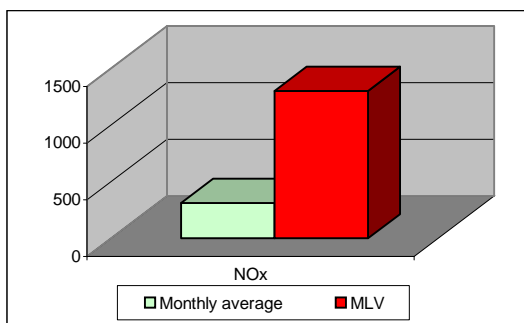
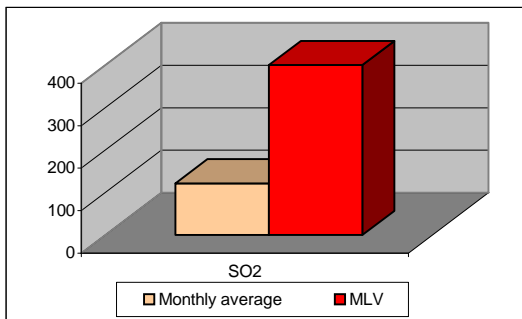


MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE- Pecka 3



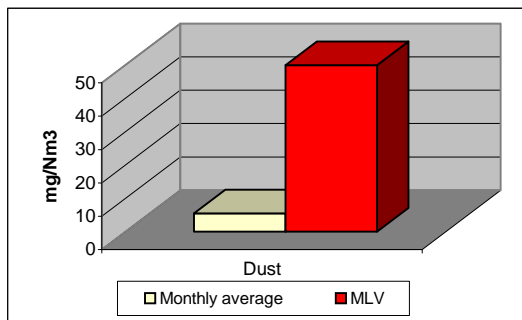


November 2008 Pecka 3	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	2	50	60	400	191	1300	
2	3	50	93	400	247	1300	
3	3	50	87	400	319	1300	
4	3	50	81	400	179	1300	
5	3	50	97	400	105	1300	
6	4	50	111	400	132	1300	
7	6	50	57	400	526	1300	
8	6	50	43	400	483	1300	
9	6	50	137	400	259	1300	
10	6	50	44	400	401	1300	
11	6	50	61	400	321	1300	
12	6	50	47	400	350	1300	
13	6	50	89	400	269	1300	
14	6	50	87	400	199	1300	
15	6	50	91	400	264	1300	
16		50		400		1300	не работи
17		50		400		1300	не работи
18		50		400		1300	не работи
19		50		400		1300	не работи
20		50		400		1300	не работи
21		50		400		1300	не работи
22	7	50	89	400	353	1300	
23		50		400		1300	
24	8	50	72	400	209	1300	
25	7	50	241	400	279	1300	
26	8	50	365	400	747	1300	
27	8	50	336	400	650	1300	
28	7	50	209	400	274	1300	
29		50		400		1300	не работи
30		50		400		1300	не работи
31		50		400		1300	не работи
Average	5	50	122	400	312	1300	

Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O₂. Results of the measurements are represented in Nm³ (Nm³ - T=273K, P=101,3kP, dry gas)

MONTHLY REPORT FROM EMISSION MONITORING IN TITAN CEMENTARNICA USJE- Pecka 4

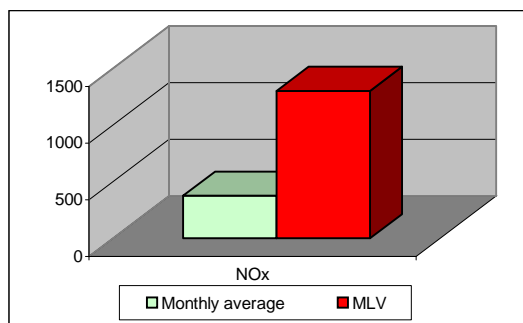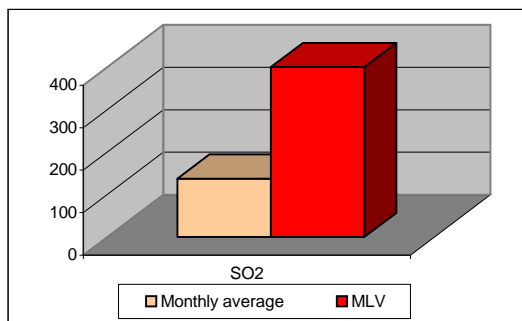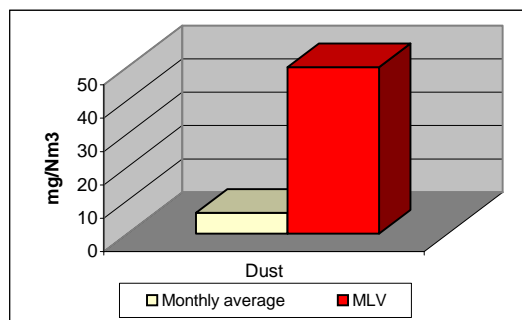

November 2008 Pecka 4	Dust (mg/Nm ³) МДК 50mg/m ³	МДК 50mg/m ³	SO ₂ (mg/Nm ³) МДК 400mg/m ³	МДК 400mg/m ³	NOx (mg/Nm ³) МДК 1300mg/m ³	МДК 1300mg/m ³	Comments
1	2	50	78	400	272	1300	
2	3	50	63	400	673	1300	
3	3	50	63	400	374	1300	
4	3	50	132	400	168	1300	
5	3	50	161	400	279	1300	
6	4	50	163	400	326	1300	
7	5	50	134	400	56	1300	
8	6	50	60	400	470	1300	
9	6	50	93	400	530	1300	
10	13	50	138	400	326	1300	
11	9	50	92	400	252	1300	
12	8	50	179	400	306	1300	
13	10	50	118	400	196	1300	
14	7	50	210	400	522	1300	
15	8	50	192	400	521	1300	
16	7	50	204	400	422	1300	
17	7	50	118	400	397	1300	
18	9	50	123	400	311	1300	
19	8	50	86	400	9	1300	
20		50		400		1300	
21	9	50	120	400	181	1300	
22	8	50	100	400	235	1300	
23		50		400		1300	
24	9	50	140	400	222	1300	
25		50		400		1300	
26	8	50	336	400	327	1300	
27	10	50	250	400	916	1300	
28	9	50	141	400	223	1300	
29	13	50	302	400	341	1300	
30	2	50	85	400	184	1300	
31	3	50	93	400	274	1300	
Average	6	50	138	400	376	1300	

Maximum Limit Value

Explanations: The monthly average values are calculated on the half hour emission values. Measured values of the concentrations are calculated at 10 vol. of O₂. Results of the measurements are represented in Nm³ (Nm³ - T=273K, P=101,3kP, dry gas)